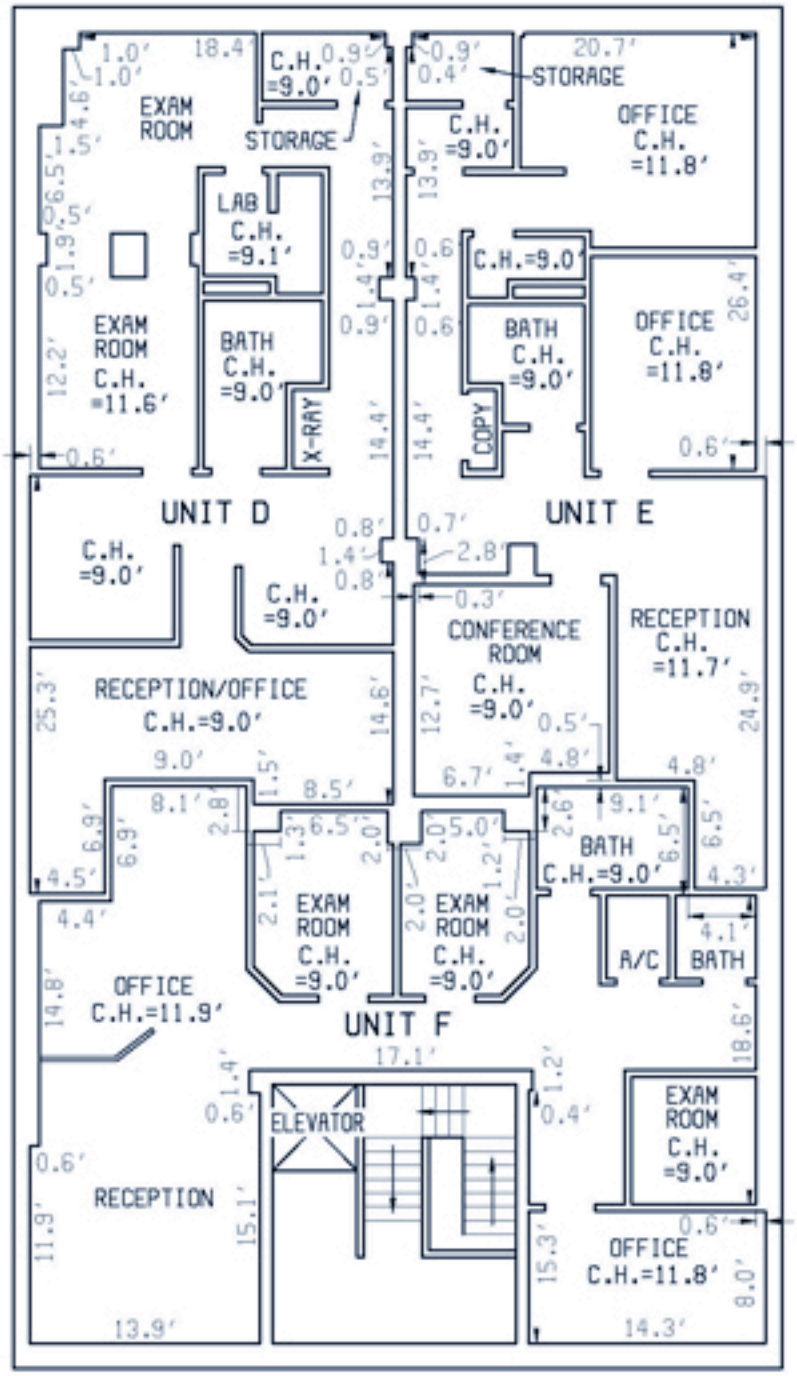
EXAM ROOM
STORAGE
C.H. =9.0'
LAB C.H. =9.1'
EXAM ROOM C.H. =11.6'
BATH C.H. =9.0'
X-RAY
STORAGE
C.H. =9.0'
OFFICE C.H. =11.8'
C.H.=9.0
BATH C.H. =9.0'
COPY
OFFICE C.H. =11.8'
UNIT D
UNIT E
C.H. =9.0'
C.H. =9.0'
CONFERENCE ROOM C.H. =9.0'
RECEPTION C.H. =11.7'
RECEPTION/OFFICE C.H.=9.0'
BATH C.H.=9.0'
EXAM ROOM C.H. =9.0'
EXAM ROOM C.H. =9.0'
A/C
BATH
OFFICE C.H.=11.9'
UNIT F
ELEVATOR
EXAM ROOM C.H. =9.0'
RECEPTION
OFFICE C.H.=11.8'

FIRST FLOOR